

Installation guide

ELIMINATOR® Hermetic burn-out filter drier Type DAS

Refrigerants R134a, R404A, R407C, R

R134a, R404A, R407C, R507, R22, R410A and other refrigerants (HCFC, HFC, HFO, HC)


Temperature range

-40 – 70 °C -40 – 160 °F


Max. working pressure

PS / MWP = 35 bar / 500 psig

Mounting




Filter installation

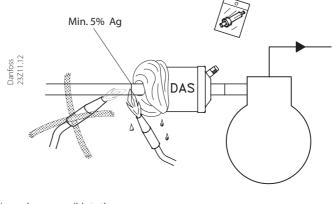

 $\dot{\mathbb{Y}}$

Install burnout drier as close as possible to the compressor.



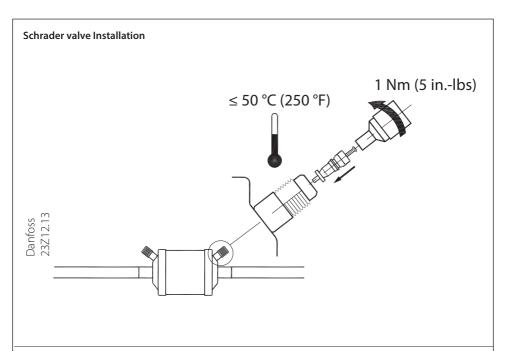

Initial pressure drop:

Record initial pressure drop and check again after 72 hours of operation. Replace drier if the pressure drop ([bar] / [psi]) across the core exceeds the following values.

Refrigerant	Evaporator temperature									
	-40 °C / -40 °F		-28.9 °C / -20 °F		-17.8 °C / 0 °F		-6.7 °C / 20 °F		4.4 °C / 40 °F	
	[bar]	[psi]	[bar]	[psi]	[bar]	[psi]	[bar]	[psi]	[bar]	[psi]
R404A, R407C, R507, R22	0.04	0.50	0.07	1.00	0.10	1.50	0.15	2.00	0.20	3.00
R134a	-	-	0.04	0.50	0.07	1.00	0.10	1.50	0.15	2.00
R410A	0.07	1.00	0.10	1.50	0.15	2.00	0.20	3.00	0.07	1.00

ny information, including, but not limited to information on selection of product, its application or use, product design, weight, dimensions, capacity or any other restricted data in product menuals, catalogues descriptions, advertinements, et a mid-whether made weighbels in writing, only celectronic point or under or underwood, shall be considered informative, and is only be added in the extent, explicit reference is made in a quotation or order confirmation. Danfoss cannot accept any responsibility for possible errors in catalogues, brochrures, videos and other material. Danfoss reserves the right to alter its products without notice. This also applies to products ordered but not delivered preded that such alterations can be made without changes to form, fit or function of the product. All trademarks in this material are property of Danfoss A/S or Danfoss group companies. Danfoss and the Danfoss logo are trademarks of Danfoss A/S. All rights reserved.